



## Q2XKLA<sup>F</sup> Laser Measurement Sensor

Original Instructions

p/n: 229259 Rev. C

07-Nov-25

© Banner Engineering Corp. All rights reserved. [www.bannerengineering.com](http://www.bannerengineering.com)

# Contents

<b>Chapter 1 Features .....</b>	<b>3</b>
Models .....	3
Specifications .....	3
Class 1 Laser Description and Safety Information.....	4
FCC Part 15 Class B for Unintentional Radiators.....	5
Industry Canada ICES-003(B) .....	5
Dimensions .....	6
Performance Curves.....	7
<b>Chapter 2 Installation.....</b>	<b>10</b>
Overview.....	10
Mount the Device.....	10
Wiring.....	10
<b>Chapter 3 IO-Link Interface .....</b>	<b>11</b>
<b>Chapter 4 Configuration Instructions.....</b>	<b>12</b>
Select the TEACH Mode.....	12
TEACH Button Overview .....	12
Remote Input Wire Menu.....	13
TEACH Procedures .....	14
TEACH the Sensor Using Two-Point Static Background Suppression.....	14
TEACH the Sensor Using One-Point Object SET .....	15
TEACH the Sensor Using One-Point Window SET (Foreground Suppression).....	16
TEACH the Sensor Using One-Point Dual Mode (Intensity + Distance) .....	17
Cancel the TEACH Process.....	17
Change the Response Speed.....	18
Lock and Unlock the Button.....	18
Pulse Frequency Modulation (PFM) .....	18
Enable the PFM Output .....	19
Disable the PFM Output .....	19
<b>Chapter 5 Accessories.....</b>	<b>20</b>
Cordsets .....	20
Brackets.....	21
<b>Chapter 6 Product Support and Maintenance .....</b>	<b>22</b>
Restoring Factory Defaults .....	22
Clean with Mild Detergent and Warm Water .....	22
Repairs .....	22
Banner Engineering Corp Limited Warranty .....	22

## Chapter Contents

Models.....	3
Specifications .....	3

# Chapter 1 Features



- Compact sensor for installation in the smallest of spaces
- Exceptional optical performance; up to 3 m sensing range in compact Q2X housing
- Background suppression models for reliable detection of objects when the background condition is not controlled or fixed
- Simple TEACH adjustment of cutoff distance
- Enhanced immunity to fluorescent lights
- Remote configuration and monitoring available over IO-Link
- Class 1 IR laser emitter

**WARNING:**

- **Do not use this device for personnel protection**
- Using this device for personnel protection could result in serious injury or death.
- This device does not include the self-checking redundant circuitry necessary to allow its use in personnel safety applications. A device failure or malfunction can cause either an energized (on) or de-energized (off) output condition.

## Models

Models	Sensing Range	Channel 1	Channel 2	Connections
Q2XKLA2IR-Q	20 mm to 2000 mm (0.8 in to 78.74 in)			150 mm (6 in) PVC-jacketed cable with a 4-pin M8 male quick-disconnect connector
Q2XKLA2IR-Q5		IO-Link, PNP output	User selectable, remote input, PNP output, or PFM Pulse Pro output	150 mm (6 in) PVC-jacketed cable with a 4-pin M12 male quick-disconnect connector
Q2XKLA3IR-Q	20 mm to 3000 mm (0.8 in to 118.1 in)			150 mm (6 in) PVC-jacketed cable with a 4-pin M8 male quick-disconnect connector
Q2XKLA3IR-Q5				150 mm (6 in) PVC-jacketed cable with a 4-pin M12 male quick-disconnect connector
Q2XNL2IR-Q	20 mm to 2000 mm (0.8 in to 78.74 in)			150 mm (6 in) PVC-jacketed cable with a 4-pin M8 male quick-disconnect connector
Q2XNL3IR-Q	20 mm to 3000 mm (0.8 in to 118.1 in)	NPN output	Remote input	150 mm (6 in) PVC-jacketed cable with a 4-pin M8 male quick-disconnect connector

## Specifications

**Supply Voltage**

10 V DC to 30 V DC (10% maximum ripple within specified limits) at less than 35 mA, exclusive of load

**Sensing Beam**

Infrared Class 1 laser (see "Class 1 Laser Description and Safety Information" on page 4)

**Sensing Range**

20 mm to 3000 mm

**Delay at Power-Up**

2 s

**Supply Protection Circuitry**

Protected against reverse polarity and transient overvoltages

**Output Configuration**

PNP with IO-Link Model:

- Channel 1: PNP discrete output and IO-Link
- Channel 2: PNP discrete output, PFM output or Remote input

NPN Model:

- Channel 1: NPN discrete output
- Channel 2: Remote input

**Output Rating**

50 mA total output current

**Off-State Leakage Current**

&lt; 10 µA at 30 V DC

**On-State Saturation Voltage**

&lt; 2.5 V at 50 mA

**IO-Link Interface**

IO-Link Revision V1.1

Smart Sensor Profile: Yes

Baud Rate: 38400 bps

Process Data In Length: 32 bits

Process Data Out Length: 8 bits

Minimum Cycle Time: 2.6 ms

IODD files: Provides all programming options of the display, plus additional functionality

**Connections**

150 mm (6 in) PVC-jacketed cable with a 4-pin M8 male quick-disconnect connector, or 150 mm (6 in) PVC-jacketed cable with a 4-pin M12 male quick-disconnect connector, depending on the model.

**Construction**

PC/ABS housing, acrylic lens cover; PVC cable, PBT adjustment switch

**Adjustments**

One TEACH push button, remote input wire

**Indicators**

Two LED indicators on the sensor top:

- Green on: Power is on
- Amber on: Output is on

**Response Speed**Fast: 33 ms<sup>(1)</sup>

Medium: 100 ms (default)

Slow: 500 ms in Xtalk or Precision Mode

<sup>(1)</sup> The range when using a 6% black card is 2 m in fast mode.**Environmental Rating**

IP67

**Operating Conditions**

-20 °C to +50 °C (-4 °F to +122 °F)

95% at +50 °C maximum relative humidity (non-condensing)

**Application Notes**

For mirror-like objects, minimize the sensor-to-object mounting distance and tilt the sensor so reflected light is directed away from the sensor when the object is present

**Certifications**Banner Engineering BV  
Park Lane, Culliganlaan 2F bus 3  
1831 Diegem, BELGIUMTurck Banner LTD Blenheim House  
Blenheim Court  
Wickford, Essex SS11 8YT  
GREAT BRITAIN**Required Overcurrent Protection****WARNING:** Electrical connections must be made by qualified personnel in accordance with local and national electrical codes and regulations.

Overcurrent protection is required to be provided by end product application per the supplied table.

Overcurrent protection may be provided with external fusing or via Current Limiting, Class 2 Power Supply.

Supply wiring leads &lt; 24 AWG shall not be spliced.

For additional product support, go to [www.bannerengineering.com](http://www.bannerengineering.com).

Supply Wiring (AWG)	Required Overcurrent Protection (A)	Supply Wiring (AWG)	Required Overcurrent Protection (A)
20	5.0	26	1.0
22	3.0	28	0.8
24	2.0	30	0.5

## Class 1 Laser Description and Safety Information

**Laser light. Do not stare into the beam.**

Complies with 21 CFR 1040.10 and 1040.11 except for deviations pursuant to Laser Notice No. 56, dated May 8, 2019.

**CLASS 1  
LASER PRODUCT****CAUTION:**

- Never stare directly into the sensor lens.
- Laser light can damage your eyes.
- Avoid placing any mirror-like object in the beam. Never use a mirror as a retroreflective target.

**CAUTION:**

- **Return defective units to the manufacturer.**
- Use of controls or adjustments or performance of procedures other than those specified herein may result in hazardous radiation exposure.
- Do not attempt to disassemble this sensor for repair. A defective unit must be returned to the manufacturer.

**CAUTION:**

- **Ne regardez jamais directement la lentille du capteur.**
- La lumière laser peut endommager la vision.
- Évitez de placer un objet réfléchissant (de type miroir) dans la trajectoire du faisceau. N'utilisez jamais de miroir comme cible rétro-réfléchissante.

**CAUTION:**

- **Tout dispositif défectueux doit être renvoyé au fabricant.**
- L'utilisation de commandes, de réglages ou de procédures autres que celles décrites dans le présent document peut entraîner une exposition dangereuse aux radiations.
- N'essayez pas de démonter ce capteur pour le réparer. Tout dispositif défectueux doit être renvoyé au fabricant.

Class 1 lasers are lasers that are safe under reasonably foreseeable conditions of operation, including the use of optical instruments for intrabeam viewing.

Complies with IEC 60825-1:2014 and EN 60825-1:2014+A11:2021.

**For safe laser use:**

- Do not stare at the laser.
- Do not point the laser at a person's eye.
- Mount open laser beam paths either above or below eye level, where practical.
- Terminate the beam emitted by the laser product at the end of its useful path.

**Class 1 Laser Characteristics**

Output power: 0.9 mW (average)

Laser wavelength: 940 nm

Pulse duration: 32.8 ms

**FCC Part 15 Class B for Unintentional Radiators**

(Part 15.105(b)) This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

(Part 15.21) Any changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate this equipment.


**Industry Canada ICES-003(B)**

This device complies with CAN ICES-3 (B)/NMB-3(B). Operation is subject to the following two conditions: 1) This device may not cause harmful interference; and 2) This device must accept any interference received, including interference that may cause undesired operation.

Cet appareil est conforme à la norme NMB-3(B). Le fonctionnement est soumis aux deux conditions suivantes : (1) ce dispositif ne peut pas occasionner d'interférences, et (2) il doit tolérer toute interférence, y compris celles susceptibles de provoquer un fonctionnement non souhaité du dispositif.

## Dimensions

All measurements are listed in millimeters [inches], unless noted otherwise. The measurements provided are subject to change.


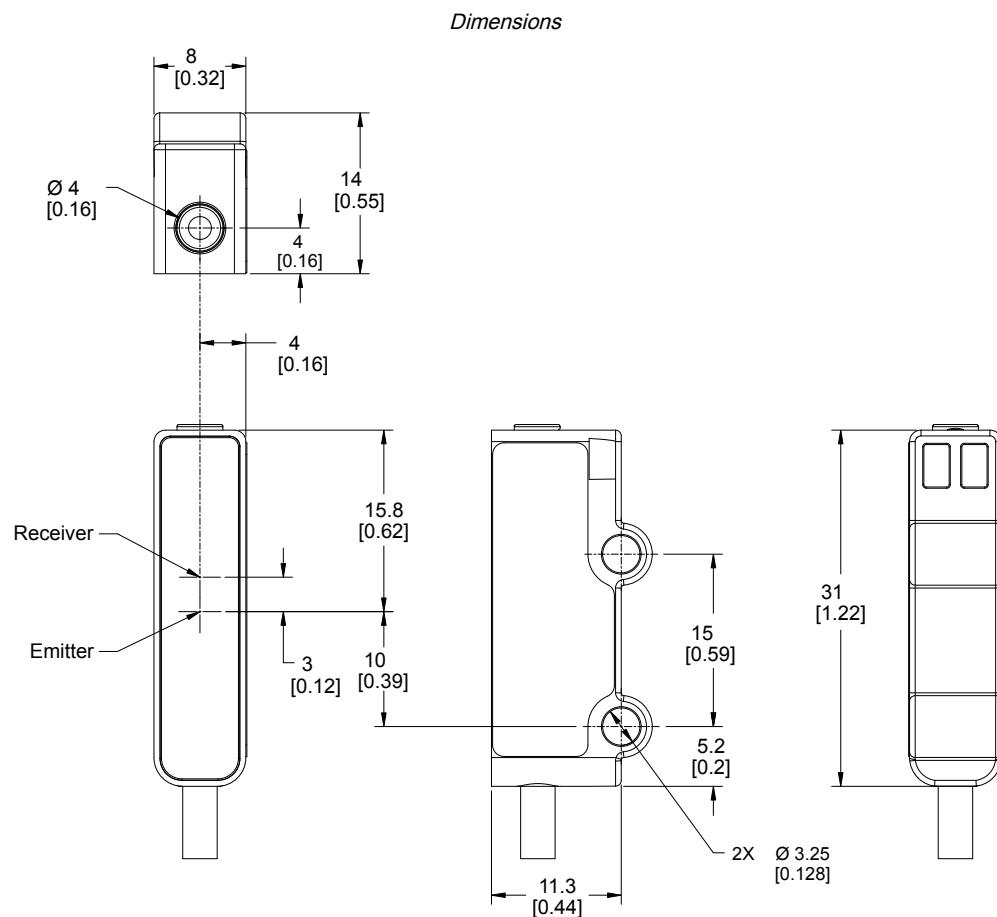


### Hardware Included:





- Two M3 x 0.5 - 6g x 16 mm SS Screws
- Two M3 x 0.5 - 6H SS Nuts
- Two M3 flat SS Washers
- Two M3 internal tooth SS Lock Washers

Maximum torque 0.9 Nm (8 in-lbf)





## Performance Curves

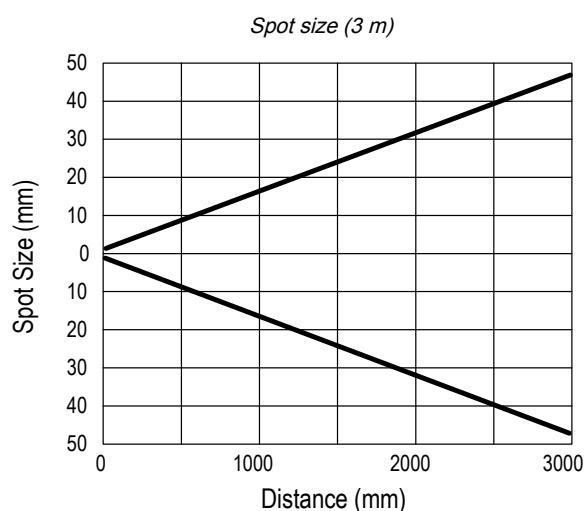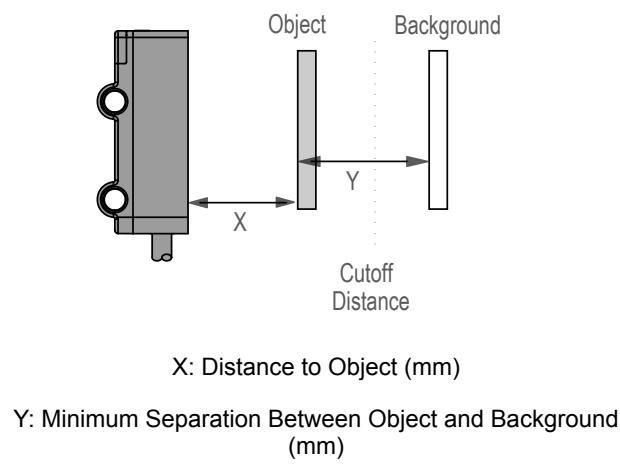

### Minimum Object Separation

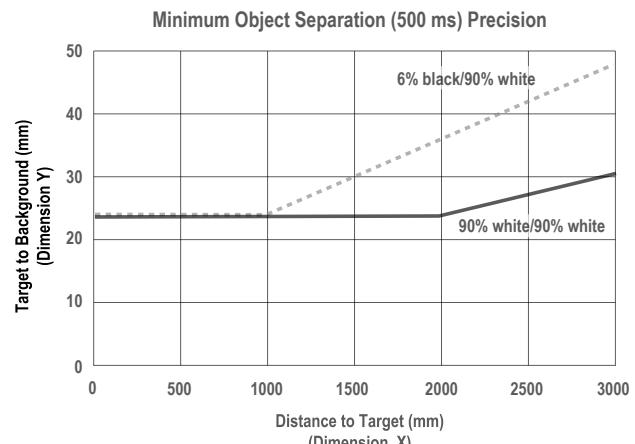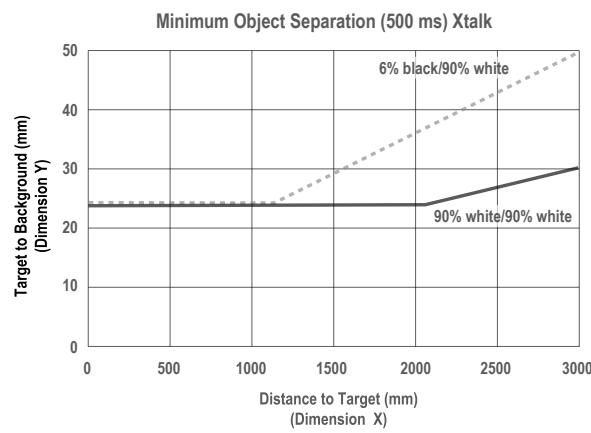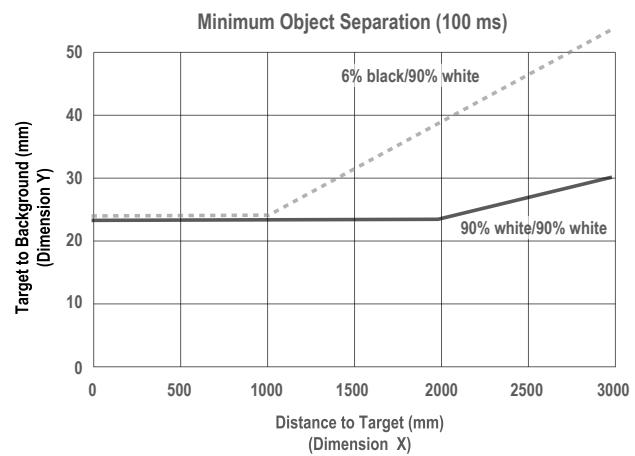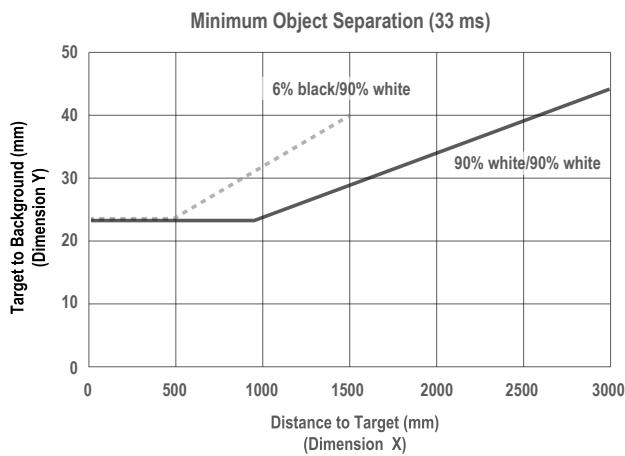


## Repeatability

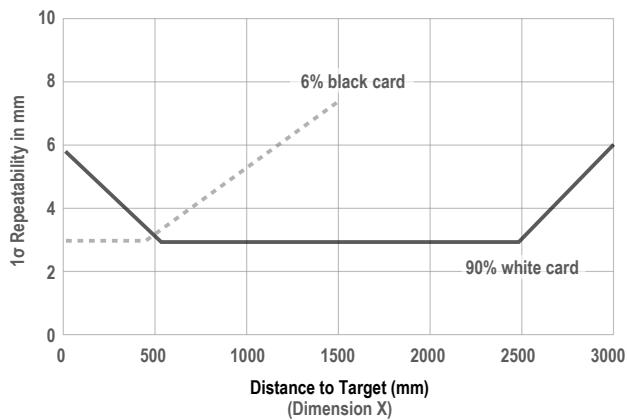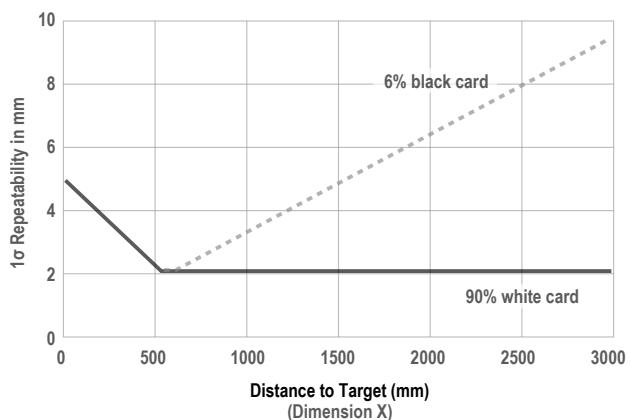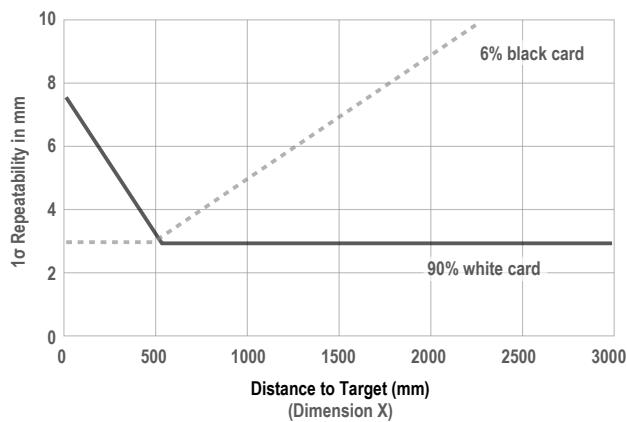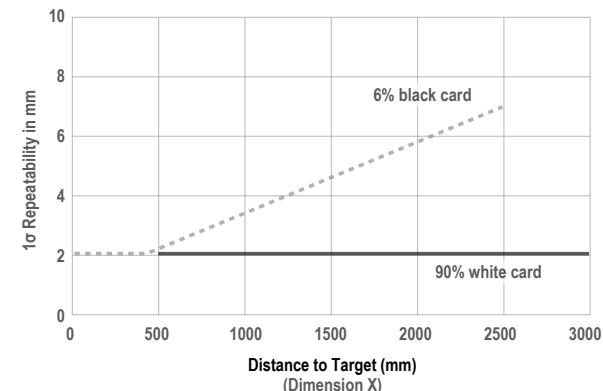
1 $\sigma$  Repeatability (33 ms)1 $\sigma$  Repeatability (100 ms)1 $\sigma$  Repeatability (500 ms) Xtalk1 $\sigma$  Repeatability (500 ms) Precision

## Accuracy

Accuracy (33 ms)


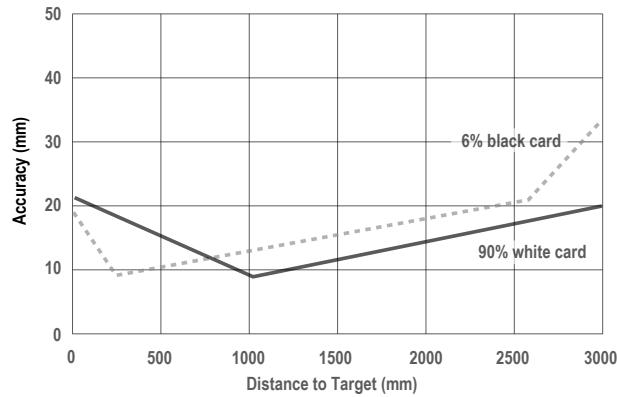


Accuracy (100 ms)

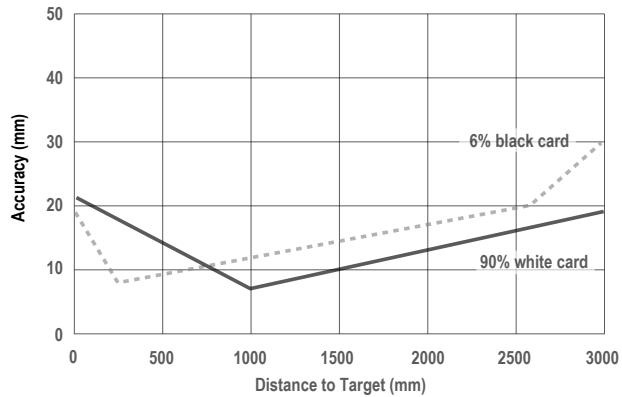

Continued on page 9

Continued from page 8

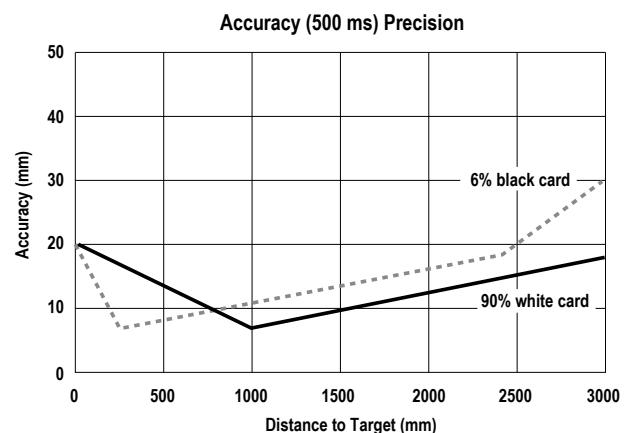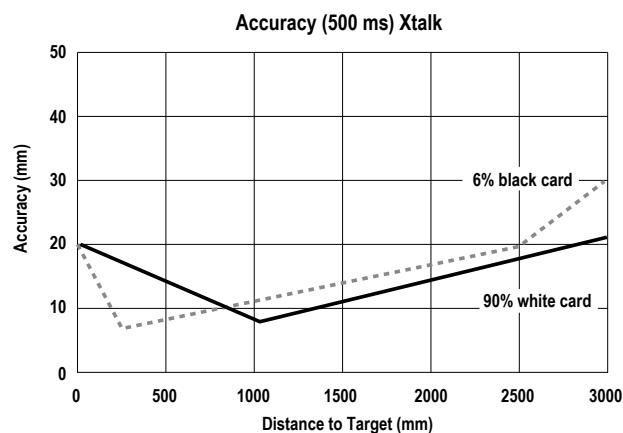

## Chapter Contents

Overview .....	10
Mount the Device .....	10
Wiring .....	10

## Chapter 2 Installation

### Overview

The Q2X Laser Measurement Sensor ignores objects beyond the set cutoff distance.

Background suppression mode can be used in most situations with varying object color and position or with varying background conditions.

1. Green: Power Indicator
2. Amber: Output Indicator
3. TEACH Button



### Mount the Device


1. If a bracket is needed, mount the device onto the bracket.
2. Mount the device (or the device and the bracket) to the machine or equipment at the desired location. Do not tighten the mounting screws at this time.
3. Check the device alignment.
4. Tighten the mounting screws to secure the device (or the device and the bracket) in the aligned position.

### Wiring




**CAUTION:** Cabled wiring diagrams are shown. Quick disconnect wiring diagrams are functionally identical. Observe proper ESD precautions (grounding) when connecting quick disconnect models.


*CH1 as PNP/IO-Link and CH2 as the Remote Input*

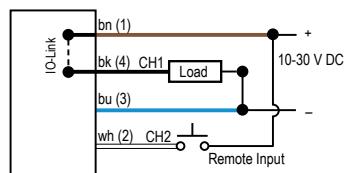


*CH1 as PNP/IO-Link and CH2 as PNP Discrete or PFM Output*

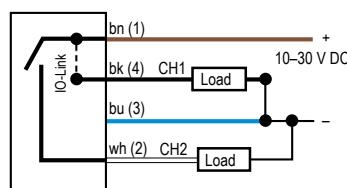

*4-pin male M8 quick disconnect connector*



*NPN and Remote Input*

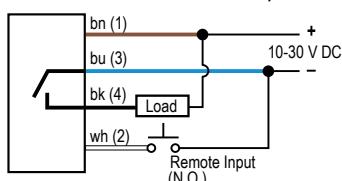

*4-pin male M12 quick disconnect connector*



## Chapter Contents

## Chapter 3 IO-Link Interface

---

IO-Link®<sup>(2)</sup> is a point-to-point communication link between a master device and sensor. Use IO-Link to parameterize sensors and transmit process data automatically.

For the latest IO-Link protocol and specifications, see [www.io-link.com](http://www.io-link.com).

Each IO-Link device has an IODD (IO Device Description) file that contains information about the manufacturer, article number, functionality etc. This information can be easily read and processed by the user. Each device can be unambiguously identified via the IODD as well as via an internal device ID. Download the Q2X's IO-Link IODD package (p/n 232947) from Banner Engineering's website at [www.bannerengineering.com](http://www.bannerengineering.com).

Banner has also developed Add On Instruction (AOI) files to simplify ease-of-use between the Q2X, multiple third-party vendors' IO-Link masters, and the Logix Designer software package for Rockwell Automation PLCs. Three types of AOI files for Rockwell Allen-Bradley PLCs are listed below. These files and more information can be found at [www.bannerengineering.com](http://www.bannerengineering.com).

**Process Data AOIs**—These files can be used alone, without the need for any other IO-Link AOIs. The job of a Process Data AOI is to intelligently parse out the Process Data word(s) in separate pieces of information. All that is required to make use of this AOI is an EtherNet/IP connection to the IO-Link Master and knowledge of where the Process Data registers are located for each port.

**Parameter Data AOIs**—These files require the use of an associated IO-Link Master AOI. The job of a Parameter Data AOI, when working in conjunction with the IO-Link Master AOI, is to provide quasi-realtime read/write access to all IO-Link parameter data in the sensor. Each Parameter Data AOI is specific to a given sensor or device.

**IO-Link Master AOIs**—These files require the use of one or more associated Parameter Data AOIs. The job of an IO-Link Master AOI is to translate the desired IO-Link read/write requests, made by the Parameter Data AOI, into the format a specific IO-Link Master requires. Each IO-Link Master AOI is customized for a given brand of IO-Link Master.

Add and configure the relevant Banner IO-Link Master AOI in your ladder logic program first; then add and configure Banner IO-Link Device AOIs as desired, linking them to the Master AOI as shown in the relevant AOI documentation.

---

<sup>(2)</sup> IO-Link® is a registered trademark of PROFIBUS Nutzerorganisation e.V.

## Chapter Contents

Select the TEACH Mode .....	12
TEACH Button Overview .....	12
Remote Input Wire Menu .....	13
TEACH Procedures .....	14
Lock and Unlock the Button .....	18
Pulse Frequency Modulation (PFM) .....	18

## Chapter 4 Configuration Instructions

### Select the TEACH Mode

Configure the sensor using the TEACH button on the sensor or the remote input (limited programming options).

To select the TEACH mode, follow these steps:

1. Put the sensor into TEACH mode.

Method	Action	Result
TEACH Button	Press and hold the TEACH button for two seconds.	
Remote Input	No action is necessary.	The amber and green LEDs flash.

2. Enter the TEACH mode selection.

Method	Action	Result
TEACH Button	Press the TEACH button three times.	
Remote Input	Pulse the remote input wire three times.	The amber and green LEDs flash three times.

3. Select the TEACH method.

TEACH Method	How to Select
One-Point Object SET	Press the TEACH button once or pulse the remote input once.
Two-Point Static Background Suppression (Default)	Press the TEACH button twice or pulse the remote input twice.
One-Point Window SET (Foreground Suppression)	Press the TEACH button three times or pulse the remote input three times.
One-Point Dual Mode (Intensity + Distance)	Press the TEACH button four times or pulse the remote input four times.
PFM Output	See "Pulse Frequency Modulation (PFM)" on page 18.

After the TEACH method has been selected, the LEDs flash the same number of times as the button press/remote pulse.


4. Continue to the appropriate procedure to finish configuring the sensor.

- "TEACH the Sensor Using One-Point Object SET" on page 15
- "TEACH the Sensor Using Two-Point Static Background Suppression" on page 14
- "TEACH the Sensor Using One-Point Window SET (Foreground Suppression)" on page 16
- "TEACH the Sensor Using One-Point Dual Mode (Intensity + Distance)" on page 17

### TEACH Button Overview

Press the TEACH button to configure the sensor.

See "TEACH Procedures" on page 14 for detailed instructions.

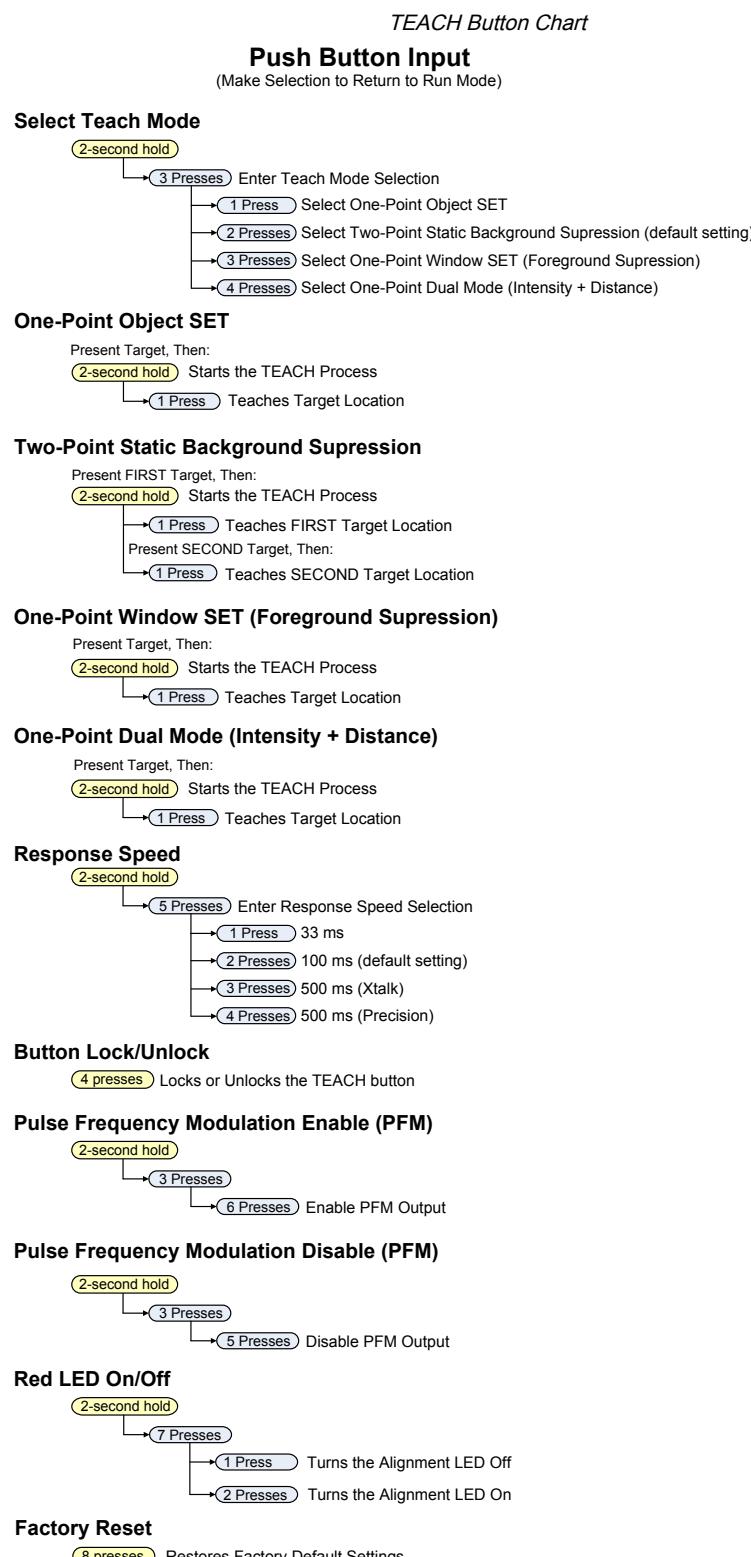

## Remote Input Wire Menu


Use the remote input wire to program the sensor remotely.

The remote input provides limited programming options. The remote input is either Active High or Active Low depending on the polarity of the sensor. If the polarity is PNP, the remote input is Active High. If polarity is NPN, the remote input is Active Low.

For Active High, connect the white wire to 24 V DC with a remote switch connected between the wire and 24 V DC. For Active Low, connect the white wire to ground (0 V DC) with a remote switch connected between the wire and ground.

Pulse the remote input according to the diagram and the instructions provided in this manual. The length of the individual programming pulses is equal to the value **T: 0.04 seconds  $\leq$  T  $\leq$  0.8 seconds**.

Exit remote programming modes by activating the remote input for longer than 2 seconds.

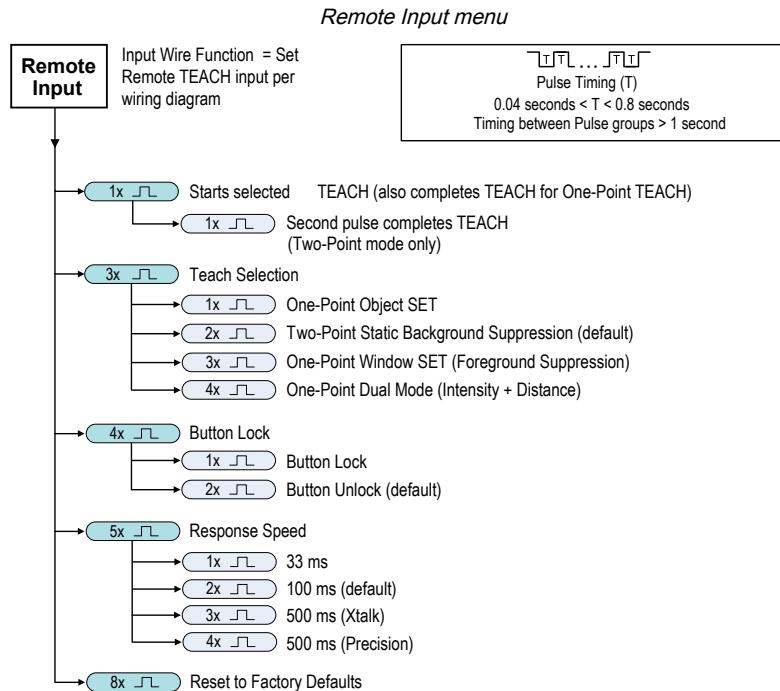

## TEACH Procedures


Use the following procedures to configure the sensor.

### TEACH the Sensor Using Two-Point Static Background Suppression

Two-Point TEACH sets a single switch point between two taught target distances. Use either the TEACH button or the remote line to teach the sensor.

The duration of each remote input pulse is defined as T, where T is  $0.04 \text{ s} \leq T \leq 0.8 \text{ s}$ .

*TEACH Process for Two-Point Static Background Suppression*

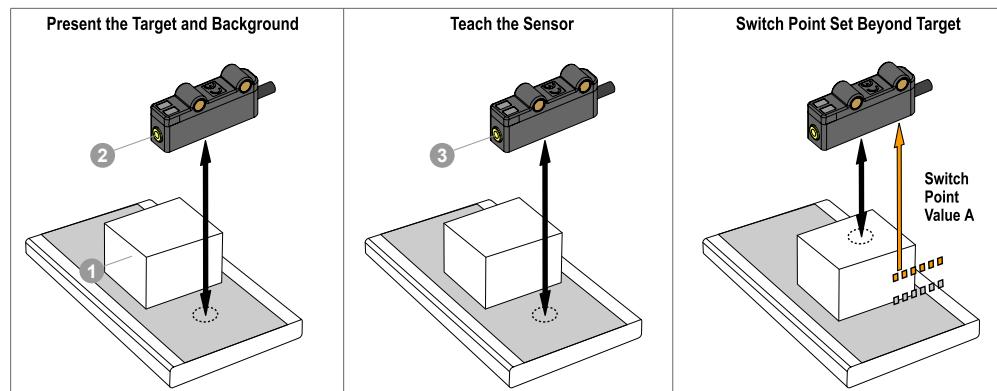

1. Select the TEACH mode (see "Select the TEACH Mode" on page 12).
2. Present the first target.

3. Start the TEACH process.

Method	Action	Result
TEACH Button	Press and hold the TEACH button for two seconds.	
Remote Input	No action is necessary.	The amber and green LEDs flash.

4. Teach the first target location.

Method	Action	Result
TEACH Button	Press the TEACH button once.	
Remote Input	Single pulse the remote input wire.	The LEDs turn off, then flash twice.

5. Present the second target.

6. Teach the second target location.

Method	Action	Result
TEACH Button	Press the TEACH button once.	
Remote Input	Single pulse the remote input wire.	The LEDs turn off, then flash as shown below.

After the sensor is taught the target locations, both LEDs flash with the results code, and then the sensor returns to Run mode.


*Results of the two-point static background suppression TEACH*

Condition	TEACH Result	Number of LED Flashes
Two points with different distance values within the sensor's range have been taught.	Sets a switch point between the two taught distance values.	Three
Two points with the same distance value within the sensor's range have been taught.	Sets a switch point in front of taught distance equal to the uniform reflectivity minimum object separation.	Six
Two points with different distance values have been taught; one point is within sensor range and the other is outside sensor range.	Sets a switch point between the taught distance and the maximum range.	Eight
Two points with distance values outside the sensor's range have been taught.	After the sensor is taught the target locations, both LEDs flash with the results code, and then the sensor returns to Run mode.	Ten

## TEACH the Sensor Using One-Point Object SET

One-Point Object SET sets a single switch point just behind the taught target distance. Objects beyond the taught switch point are ignored.

The duration of each remote input pulse is defined as T, where T is  $0.04 \text{ s} < T < 0.8 \text{ s}$ .

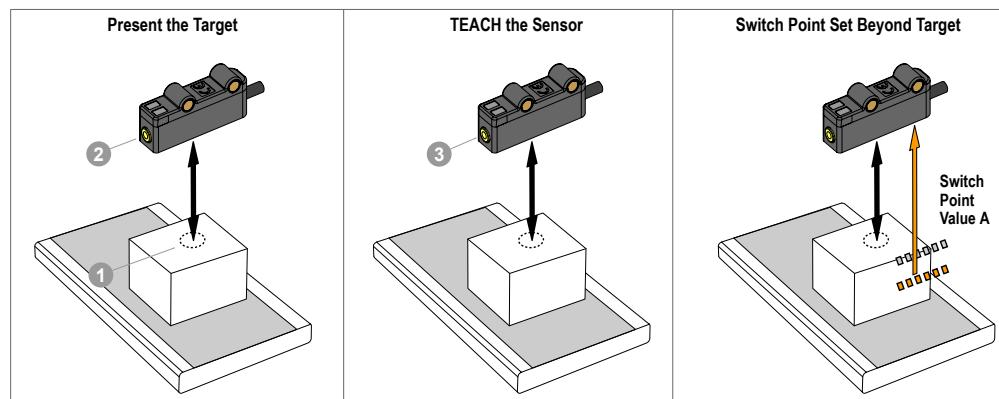*TEACH Process for One-Point Object SET*

1. Select the TEACH mode (see "Select the TEACH Mode" on page 12).
2. Present the first target.
3. Start the TEACH process.

Method	Action	Result
TEACH Button	Press and hold the TEACH button for two seconds.	
Remote Input	No action is necessary.	The amber and green LEDs flash.

4. Teach the target location.


Method	Action	Result
TEACH Button	Press the TEACH button once.	
Remote Input	Single pulse the remote input wire.	The LEDs turn off, then flash three times.

After the sensor is taught the target location, both LEDs flash with the results code, and then the sensor returns to Run mode.

**TEACH the Sensor Using One-Point Window SET (Foreground Suppression)**

One-Point Window SET defines a window (two switch points) centered around the taught target distance.

The duration of each remote input pulse is defined as T, where T is  $0.04 \text{ s} < T < 0.8 \text{ s}$ .

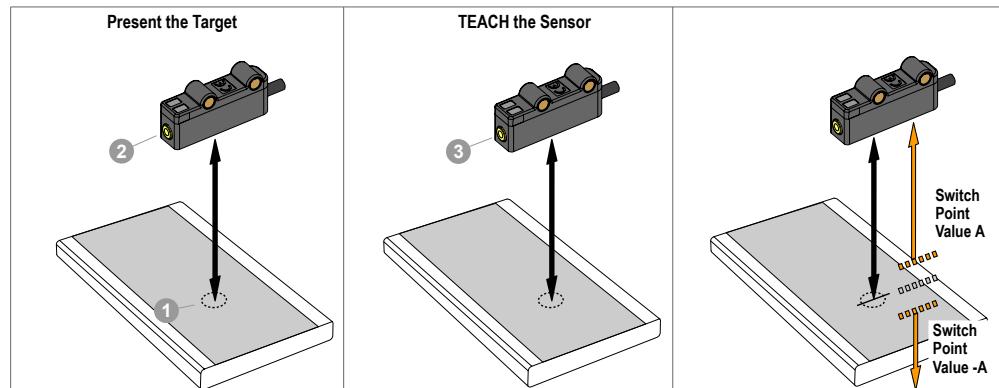*TEACH Process for One-Point Window SET (FGS)*

1. Select the TEACH mode (see "Select the TEACH Mode" on page 12).
2. Present the target.
3. Start the TEACH process.

Method	Action	Result
TEACH Button	Press and hold the TEACH button for two seconds.	
Remote Input	No action is required.	The amber and green LEDs flash.

#### 4. Teach the target.

Method	Action	Result
TEACH Button	Press the TEACH button once.	
Remote Input	Single pulse the remote input.	The LEDs turn off, then flash three times.


After the sensor is taught the target location, both LEDs flash with the results code, and then the sensor returns to Run mode.

## TEACH the Sensor Using One-Point Dual Mode (Intensity + Distance)

Dual (Intensity + Distance) TEACH records the distance and amount of light received from the reference surface. The output switches when an object passing between the sensor and the reference surface changes the perceived distance or amount of returned light.

The duration of each remote input pulse is defined as T, where T is  $0.04 \text{ s} < T < 0.8 \text{ s}$ .

*TEACH Process for One-Point Dual Mode*

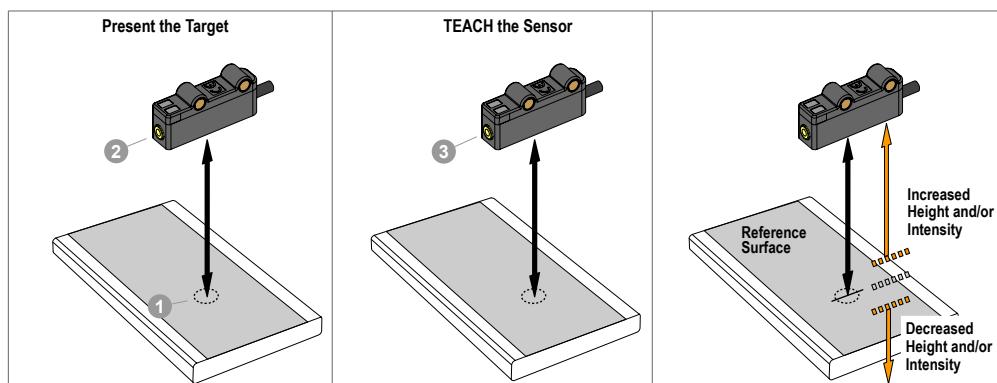

1. Select the TEACH mode (see "Select the TEACH Mode" on page 12).
2. Present the target.
3. Start the TEACH process.

Method	Action	Result
TEACH Button	Press and hold the TEACH button for two seconds.	
Remote Input	No action is required.	The amber and green LEDs flash.

#### 4. Teach the target.

Method	Action	Result
TEACH Button	Press the TEACH button once.	
Remote Input	Single pulse the remote input line.	The LEDs turn off, then flash three times.

After the sensor is taught the target locations, both LEDs flash with the results code, and then the sensor returns to Run mode.

## Cancel the TEACH Process

1. When the LED indicators are flashing, press and hold the TEACH button for two seconds.

The amber and green LEDs flash alternately.

2. Release the TEACH button.

The sensor returns to Run mode.

The TEACH process cannot be canceled using the remote input wire.

## Change the Response Speed

Follow these steps to change the response speed.

1. Put the sensor into TEACH mode.

Method	Action	Result
TEACH Button	Press and hold the TEACH button for two seconds.	
Remote Input	No action is necessary.	The amber and green LEDs flash.

2. Select Response Speed.

Method	Action	Result
TEACH Button	Press the TEACH button five times.	
Remote Input	Pulse the remote input wire five times.	The amber and green LEDs flash five times.

3. Choose the response speed.

Response Speed	How to Select
33 ms	Press the TEACH button once or pulse the remote input once.
100 ms (default setting)	Press the TEACH button twice or pulse the remote input twice.
500 ms (Xtalk mode)	Press the TEACH button three times or pulse the remote input three times.
500 ms (Precision mode)	Press the TEACH button four times or pulse the remote input four times.

In Xtalk mode, the Q2X is more resistant to crosstalk. In Precision mode, the Q2X has the best repeatability.

## Lock and Unlock the Button

Follow these steps to lock or unlock the TEACH button.

1. Initiate the button locking or unlocking procedure.

Method	Action	Result
TEACH Button	No action.	
Remote Input	Pulse the wire four times.	The LEDs flash four times.

2. Lock or unlock the button.

Method	Action	Result
TEACH Button	Press the TEACH button four times.	
Remote Input	To lock the button: Single-pulse the remote input wire. To unlock the button: Double-pulse the remote input wire.	The green LED flashes four times.

## Pulse Frequency Modulation (PFM)

The Q2X Laser Measurement Sensor can be configured to generate pulses on the white wire (pin 2).

The pulse frequency is proportional to the sensor's measured distance to represent an analog signal with only a discrete counter. The sensing range of the sensor is scaled from 100 Hz to 600 Hz, where 100 Hz represents the sensor's near-range limit (20 mm) and 600 Hz represents the sensor's far-range limit (3000 mm).

An output of 50 Hz represents a loss of signal condition where there is no target or the target is out of the sensor's range. There is a two-second delay before the sensor sets the output to 50 Hz to indicate loss of signal. During the two seconds, the output holds the last PFM value.

The white wire (pin 2) can be configured as a PFM output using either the TEACH button or by sending a parameter via IO-Link. While PFM is enabled, the remote input is disabled.

## Enable the PFM Output

Follow these steps to enable the PFM output. This changes the white wire (pin 2) from a remote TEACH input to a PFM output.

1. Press and hold the TEACH button for two seconds.  
The amber and green LEDs flash.
2. Press the TEACH button three times.  
The amber and green LEDs flash three times.
3. Press the TEACH button six times.  
The amber and green LEDs flash six times and the PFM output is enabled.

## Disable the PFM Output

Follow these steps to disable the PFM output. This changes the white wire (pin 2) from a PFM output to a remote TEACH input.

1. Press and hold the TEACH button for two seconds.  
The amber and green LEDs flash.
2. Press the TEACH button three times.  
The amber and green LEDs flash three times.
3. Press the TEACH button five times.  
The LEDs flash five times and the PFM output is disabled.

## Chapter Contents


Cordsets	20
Brackets	21

## Chapter 5


Accessories

## Cordsets


4-pin Single-Ended M8 Female Cordsets (datasheet p/n 236623)				
Model	Length	Dimensions (mm)	Pinout (Female)	
BC-M8F4-24-0.5	0.5 m (1.64 ft)			
BC-M8F4-24-1	1 m (3.28 ft)			
BC-M8F4-24-2	2 m (6.56 ft)			
BC-M8F4-24-5	5 m (16.4 ft)			
BC-M8F4-24-8	8 m (26.25 ft)			
BC-M8F4-24-10	10 m (30.81 ft)			

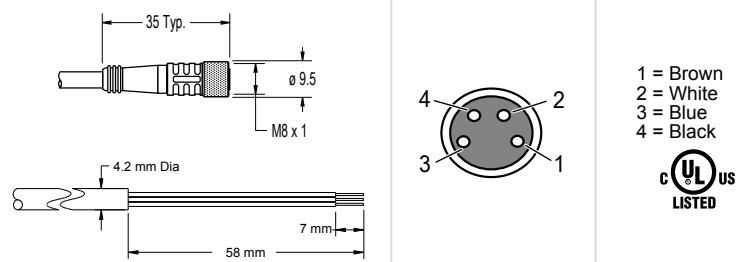

4-pin Single-Ended M12 Female Cordsets (datasheet p/n 235937)				
Model	Length	Dimensions (mm)	Pinout (Female)	
BC-M12F4-22-1	1 m (3.28 ft)			
BC-M12F4-22-2	2 m (6.56 ft)			
BC-M12F4-22-5	5 m (16.4 ft)			
BC-M12F4-22-8	8 m (26.25 ft)			
BC-M12F4-22-10	10 m (30.81 ft)			
BC-M12F4-22-15	15 m (49.2 ft)			
BC-M12F4-22-20	20 m (65.61 ft)			
BC-M12F4-22-25	25 m (82.02 ft)			
BC-M12F4-22-30	30 m (98.42 ft)			

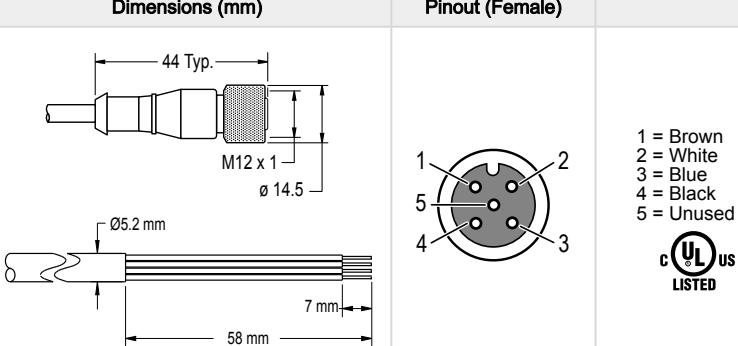

4-pin Single-Ended M12 Female Right-Angle Cordsets (datasheet p/n 235937)				
Model	Length	Dimensions (mm)	Pinout (Female)	
BC-M12F4A-22-1	1 m (3.28 ft)			
BC-M12F4A-22-2	2 m (6.56 ft)			
BC-M12F4A-22-5	5 m (16.4 ft)			
BC-M12F4A-22-8	8 m (26.25 ft)			
BC-M12F4A-22-10	10 m (30.81 ft)			
BC-M12F4A-22-15	15 m (49.2 ft)			

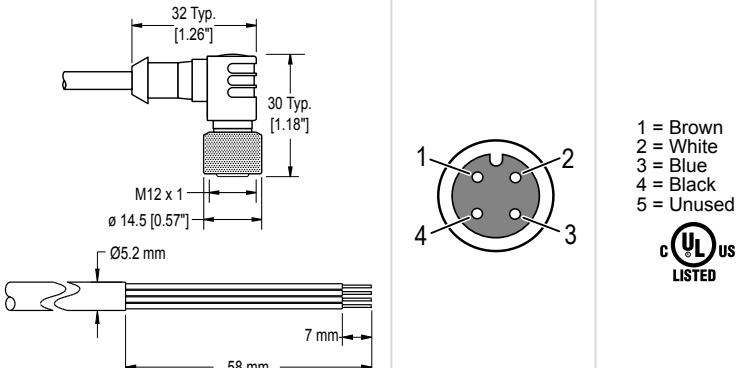


# Brackets

All measurements are listed in millimeters, unless noted otherwise. The measurements provided are subject to change.


## SMBQ2XA

- Vertical L-shaped bracket
- 20-ga stainless steel




## SMBQ2XB

- Rear L-shaped bracket
- 20-ga stainless steel



## SMBQ20FA

- Includes 3/8-16 x 2 in socket head cap screw (SHCS)
- 304 stainless steel




## SMBQ20FAM10

- Kit for 10 mm (3/8 in) Rod Bracket Systems for Q2X, Q20, Q12, VS1, VS3, VS8
- Includes M10-1.5 x 50 mm Socket Head Cap Screw (SHCS)



## SMBQ20FAM12

- Kit for 12 mm (1/2 in) Rod Bracket Systems for Q2X, Q20, Q12, VS1, VS3, VS8
- No socket head cap screw (SHCS) included



## Chapter Contents

Restoring Factory Defaults.....	22
Clean with Mild Detergent and Warm Water .....	22
Repairs .....	22
Banner Engineering Corp Limited Warranty.....	22

## Chapter 6 Product Support and Maintenance

### Restoring Factory Defaults

To restore factory default settings:

- 8-pulse the remote wire, or
- Press the TEACH button eight times.

After the factory default settings are restored, both LEDs flash eight times.

### Clean with Mild Detergent and Warm Water

Handle the sensor with care during installation and operation. Sensor windows soiled by fingerprints, dust, water, oil, etc. create stray light that may degrade the peak performance of the sensor.

Wipe down the device with a soft cloth dampened with a mild detergent and warm water solution. Do not use any other chemicals for cleaning.

### Repairs

Contact Banner Engineering for troubleshooting of this device. **Do not attempt any repairs to this Banner device; it contains no field-replaceable parts or components.** If the device, device part, or device component is determined to be defective by a Banner Applications Engineer, they will advise you of Banner's RMA (Return Merchandise Authorization) procedure.

**IMPORTANT:** If instructed to return the device, pack it with care. Damage that occurs in return shipping is not covered by warranty.

### Banner Engineering Corp Limited Warranty

Banner Engineering Corp. warrants its products to be free from defects in material and workmanship for one year following the date of shipment. Banner Engineering Corp. will repair or replace, free of charge, any product of its manufacture which, at the time it is returned to the factory, is found to have been defective during the warranty period. This warranty does not cover damage or liability for misuse, abuse, or the improper application or installation of the Banner product.

**THIS LIMITED WARRANTY IS EXCLUSIVE AND IN LIEU OF ALL OTHER WARRANTIES WHETHER EXPRESS OR IMPLIED (INCLUDING, WITHOUT LIMITATION, ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE), AND WHETHER ARISING UNDER COURSE OF PERFORMANCE, COURSE OF DEALING OR TRADE USAGE.**

This Warranty is exclusive and limited to repair or, at the discretion of Banner Engineering Corp., replacement. **IN NO EVENT SHALL BANNER ENGINEERING CORP. BE LIABLE TO BUYER OR ANY OTHER PERSON OR ENTITY FOR ANY EXTRA COSTS, EXPENSES, LOSSES, LOSS OF PROFITS, OR ANY INCIDENTAL, CONSEQUENTIAL OR SPECIAL DAMAGES RESULTING FROM ANY PRODUCT DEFECT OR FROM THE USE OR INABILITY TO USE THE PRODUCT, WHETHER ARISING IN CONTRACT OR WARRANTY, STATUTE, TORT, STRICT LIABILITY, NEGLIGENCE, OR OTHERWISE.**

Banner Engineering Corp. reserves the right to change, modify or improve the design of the product without assuming any obligations or liabilities relating to any product previously manufactured by Banner Engineering Corp. Any misuse, abuse, or improper application or installation of this product or use of the product for personal protection applications when the product is identified as not intended for such purposes will void the product warranty. Any modifications to this product without prior express approval by Banner Engineering Corp will void the product warranties. All specifications published in this document are subject to change; Banner reserves the right to modify product specifications or update documentation at any time. Specifications and product information in English supersede that which is provided in any other language. For the most recent version of any documentation, refer to: [www.bannerengineering.com](http://www.bannerengineering.com).

For patent information, see [www.bannerengineering.com/patents](http://www.bannerengineering.com/patents).



[LinkedIn](#)



[X](#)



[Facebook](#)



[Instagram](#)

